



## Integrated CO<sub>2</sub> booster for high-efficiency cooling, heating and air- conditioning

*By Jens Kallesøe, Advansor*

# COOP Maxi Mat Tocksfors

## Choosing SIGMA system from Advansor

$\Sigma$  Sum of all levels of thermal energy.

Low temperature

Medium temperature

AC Temperature

Heat Recovery + HP function

$\Sigma$  Sum of BENEFITS

# Detail of the systems installed

- 2 identical systems installed
- LT load: 2x28kW @ -35°C
- MT load: 2x80kW @ -10°C
- AC load: 2x50kW @ 12/7°C Eth. Glycol
- Heat Recovery: 2x134kW @ 40/70°C
- Artificial Load on gascooler evaporator: 2x25kW @ -10°C



solutions for europe

natural refrigerants


15-16 October 2013, Brussels

# Schematic design of SIGMA Systems – PATENTED SOLUTIONS

- False load evaporator integrated in the gascooler for artificial load on MT compressors

- Parallel/AC compressors for optimized COP, When AC is needed

- Flooded AC evaporator

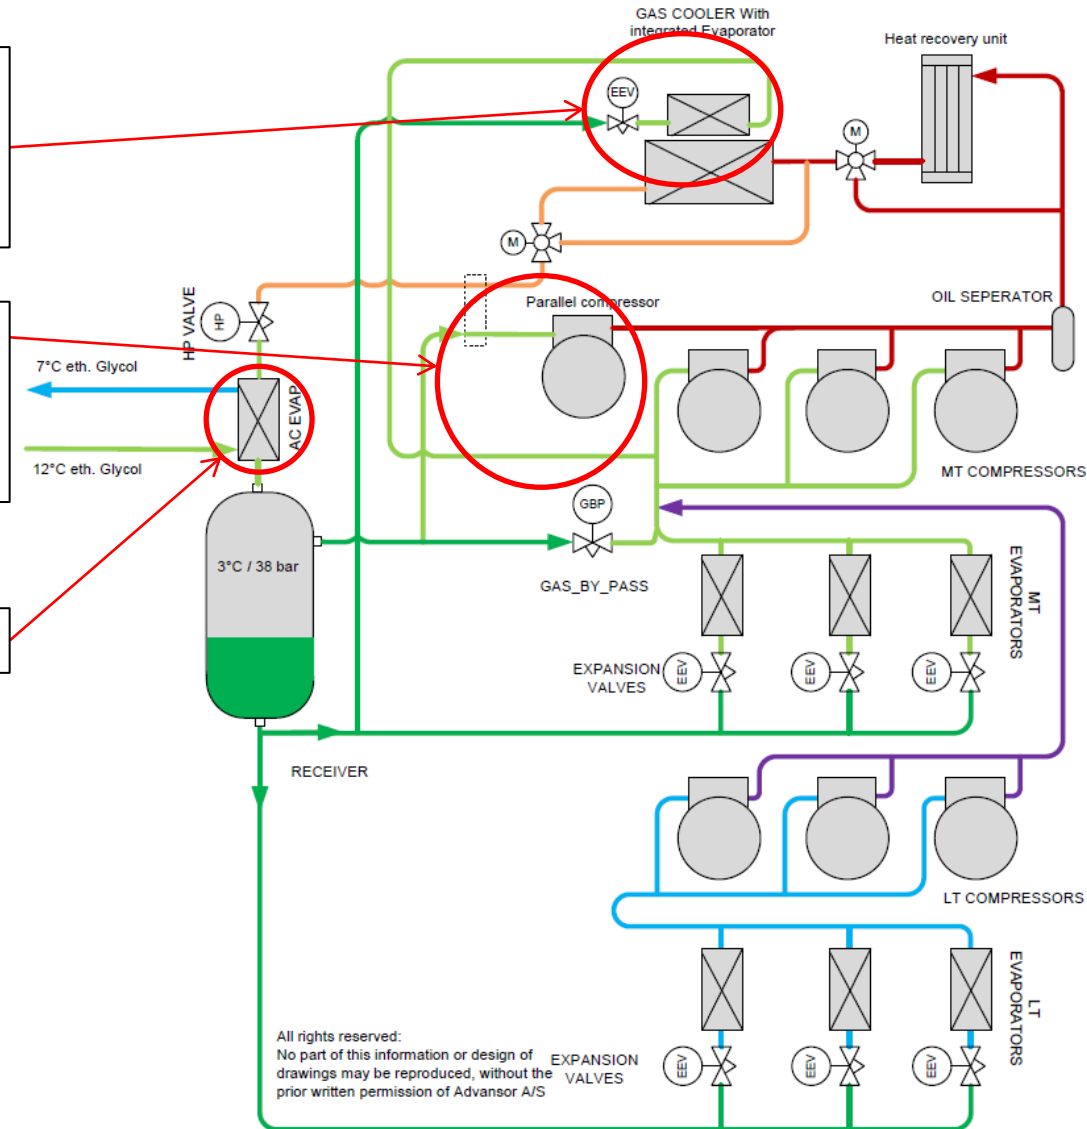

All rights reserved:  
No part of this information or design of drawings may be reproduced, without the prior written permission of Advansor A/S



solutions for europe

natural refrigerants

15-16 October 2013, Brussels

# Energy performance with parallel compression

Without AC load and compared to Traditional CO<sub>2</sub> Booster

R744 Ref. W.C. Keybolds: Thermodynamic Properties in SI

DTU, Department of Energy Engineering  
s in [kJ/kg K], v in [m<sup>3</sup>/kg], T in [°C]  
M.L. Duvrup & H.L.H. Knudsen, 13-09-10


**Ambient air T: 35°**

$P_{\text{with GBP}} = 71\text{kW}$

$P_{\text{with parallel}} = 60\text{kW}$

15% saving in design

**Only few running hours a year!!**

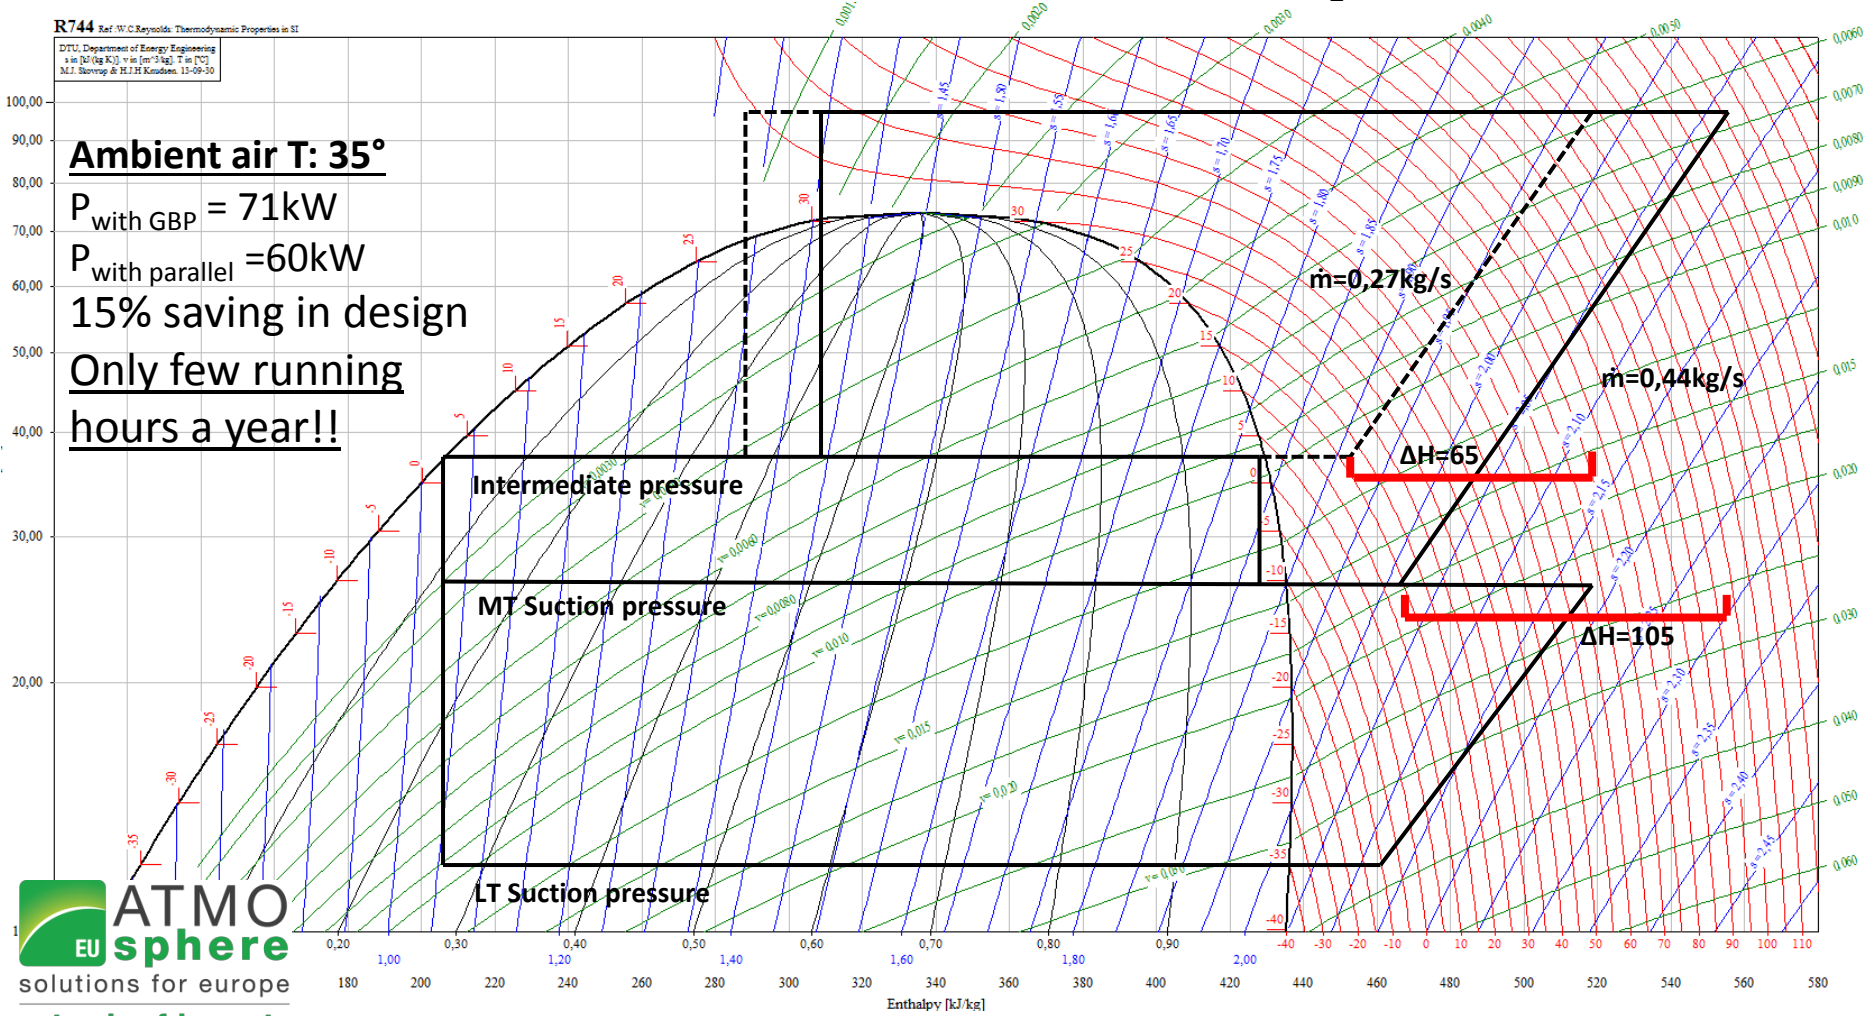

**ATMO**  
EU **sphere**  
solutions for europe  
natural refrigerants

15-16 October 2013, Brussels

# Energy performance with parallel compression

Without AC load and compared to Traditional CO<sub>2</sub> Booster

R744 Ref. W.C. Keybolds: Thermodynamic Properties in SI

DTU, Department of Energy Engineering  
s in [kJ/kg], v in [m<sup>3</sup>/kg], T in [°C]  
M.L. Duvrup & H.L.H. Knudsen, 13-09-10

**Ambient air T: 20°**


$P_{\text{with GBP}} = 36\text{kW}$

$P_{\text{with parallel}} = 33\text{kW}$

8% saving.

Average savings pr.

Year.

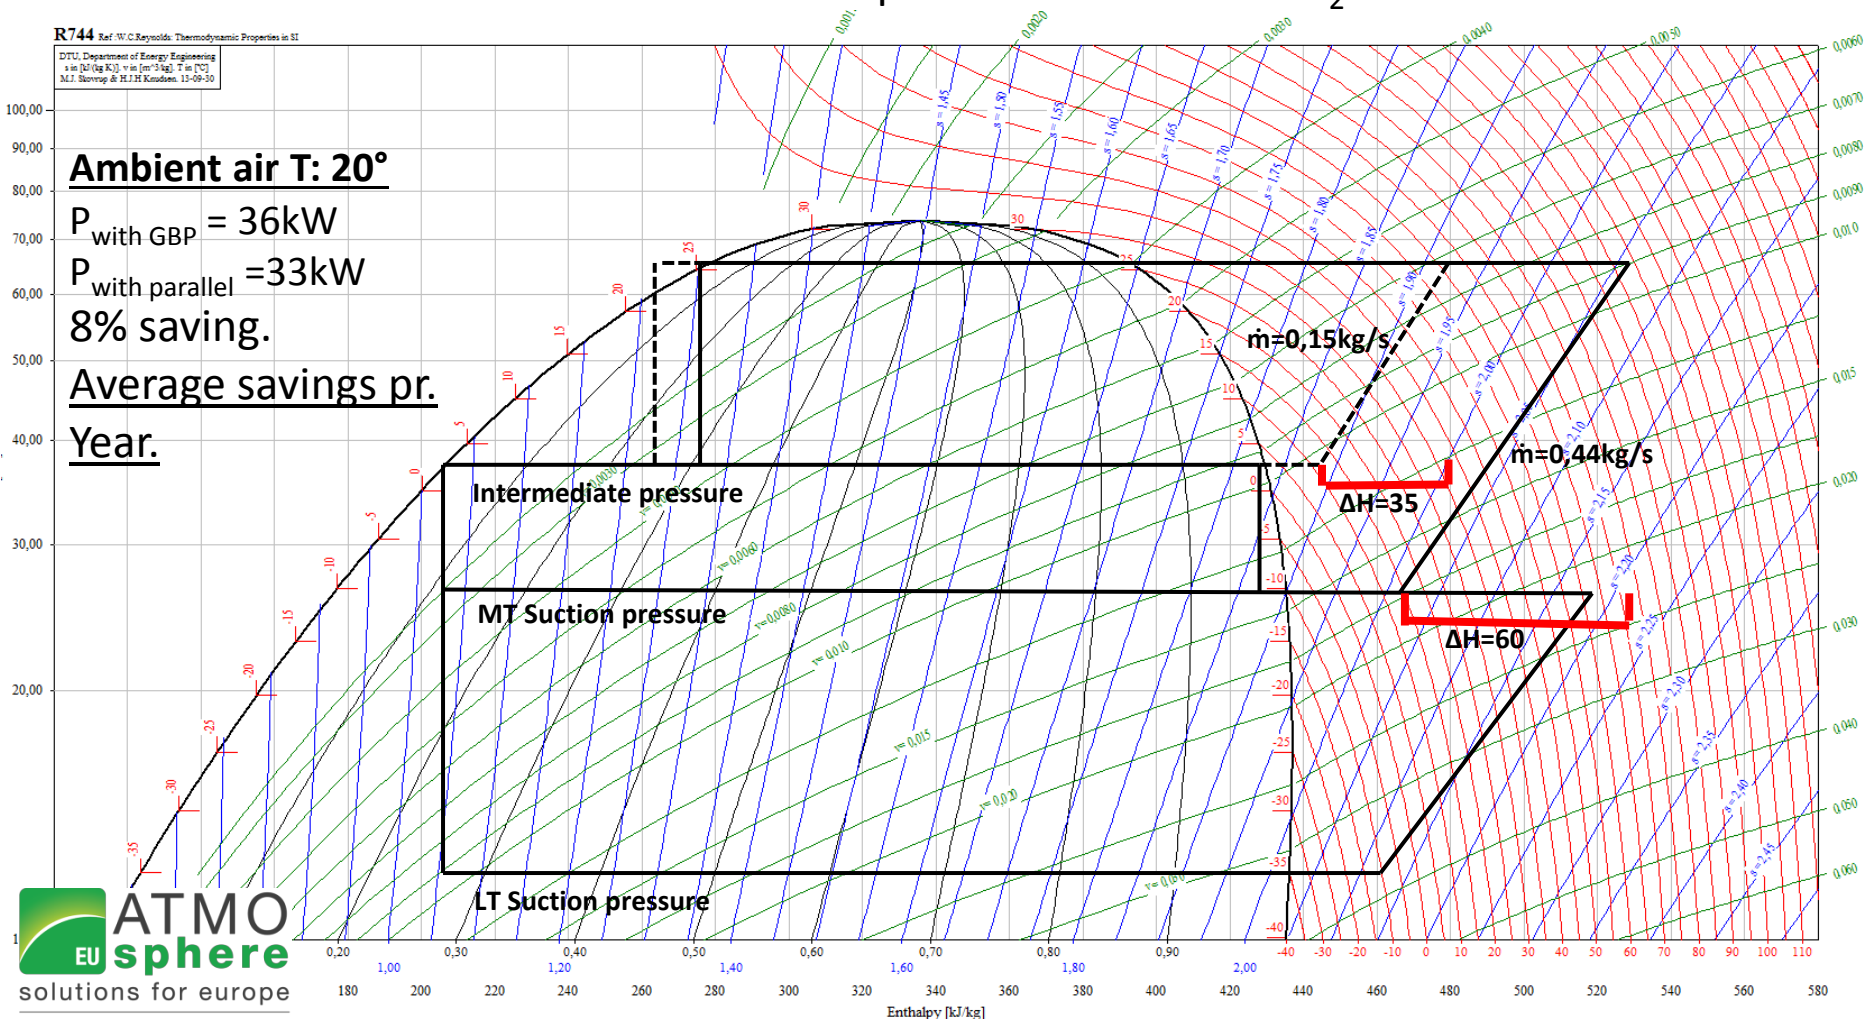


**ATMO**  
**EU sphere**  
solutions for europe  
natural refrigerants

15-16 October 2013, Brussels

**ADVANSOR**  
PHOENIX

# Energy savings throughout a year

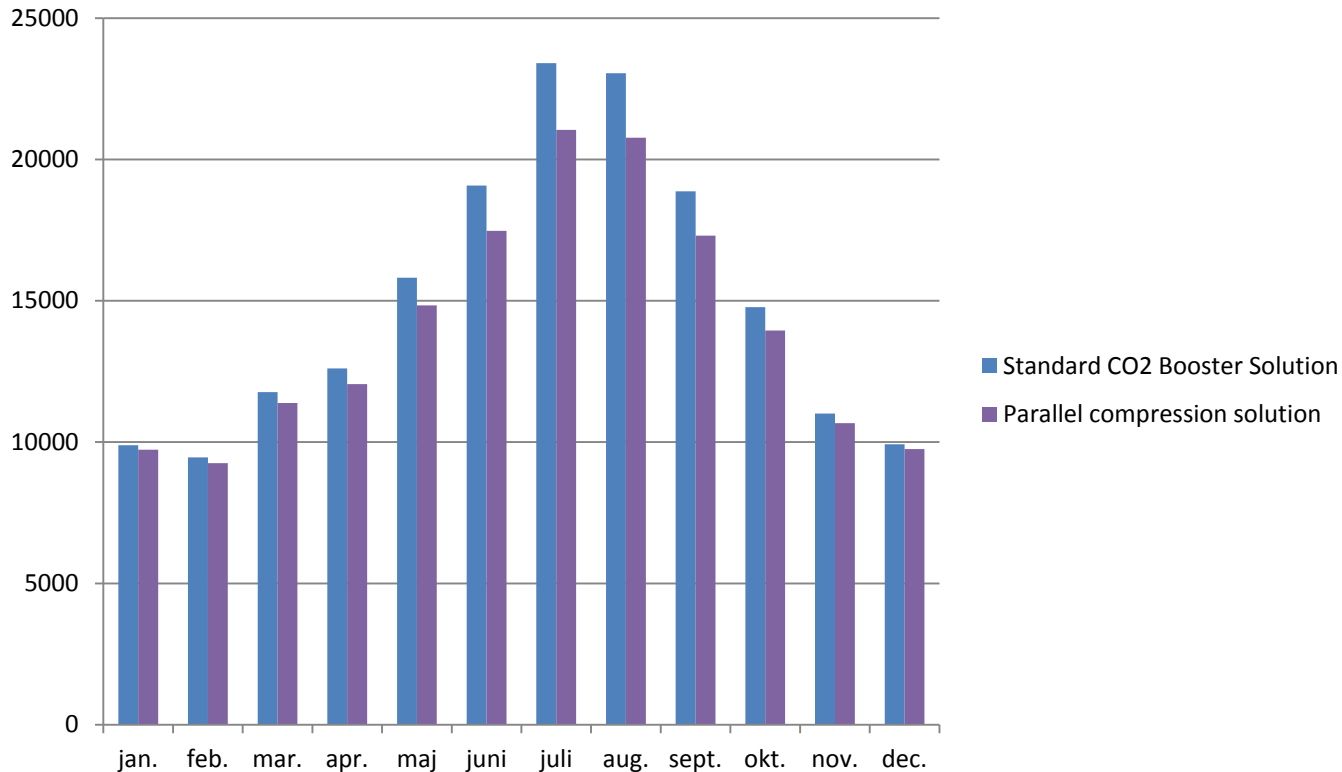

Total energy savings during a year:

Refrigeration purpose only : 6,3 %

Refrigeration & Heating purposes : approx 11 %

Data from Pack Calculation II ver. 3.07


- [WWW.IPU.DK](http://WWW.IPU.DK)

# Heat Reclaim with Parallel compression and False load evaporator

## Heat Reclaim with 5 stages

- Stage 1: Activate HR
- Stage 2: Raise Pressure
- Stage 3: Stop Fans
- Stage 4: by pass gascooler
- Stage 5: Start false load

When Stage 2 is activated Gas concentration will raise in the Receiver, which will activate parallel compressors

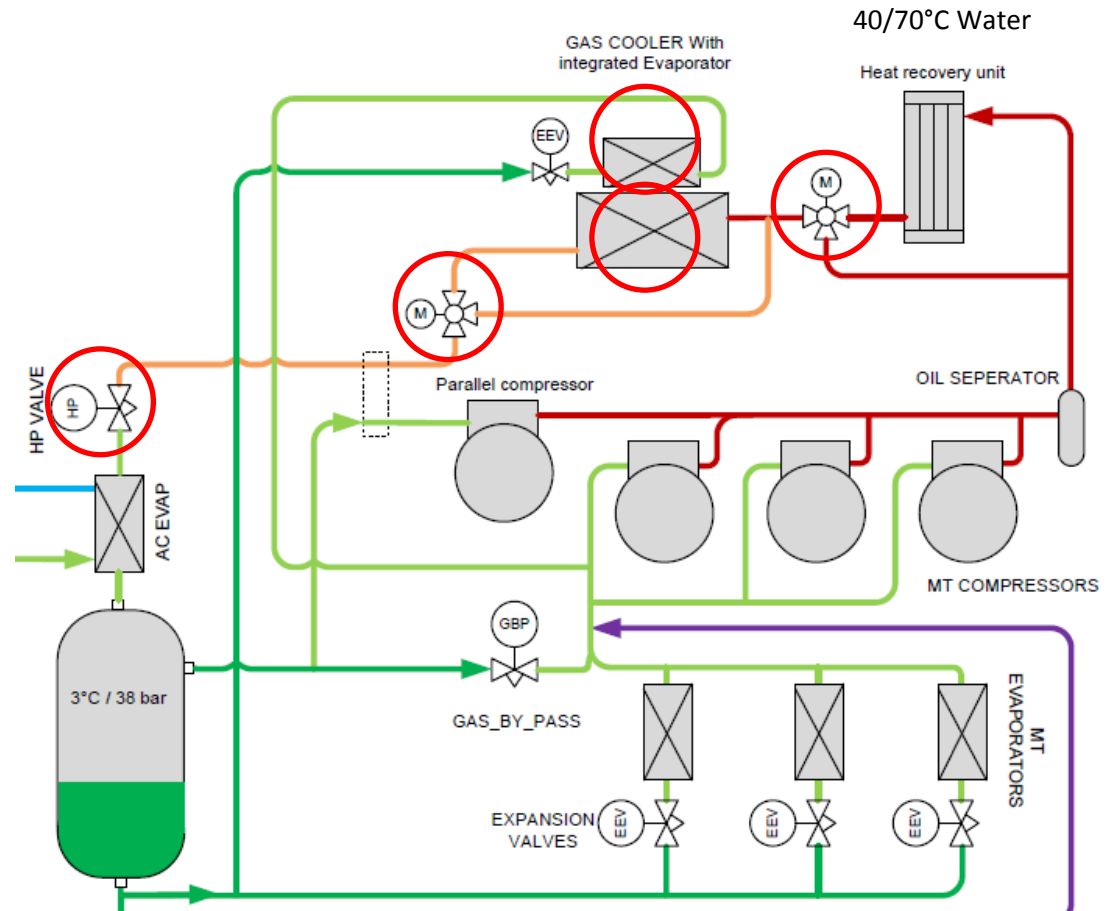



# Heat Recovery with Parallel compression and False load evaporator

Heat\_COP improves when Parallel compressors are activated.

Heat\_COP from MT compressors: 2,3

Heat\_COP from PA compressors: 3,2

False load evaporator ensure artificial loads on MT compressors, when there is low loads from Cabinets and cold rooms.

COOP MAXI mat Tocksfors is able to produces more heat, than the store needs.  
Surplus Heat is deliver to district heating.



solutions for europe


natural refrigerants

15-16 October 2013, Brussels



# Sites with SIGMA System

- 9 system with SIGMA
- 7 of them with with LT, MT, AC and HR
- 2 of them with LT, MT and HR.

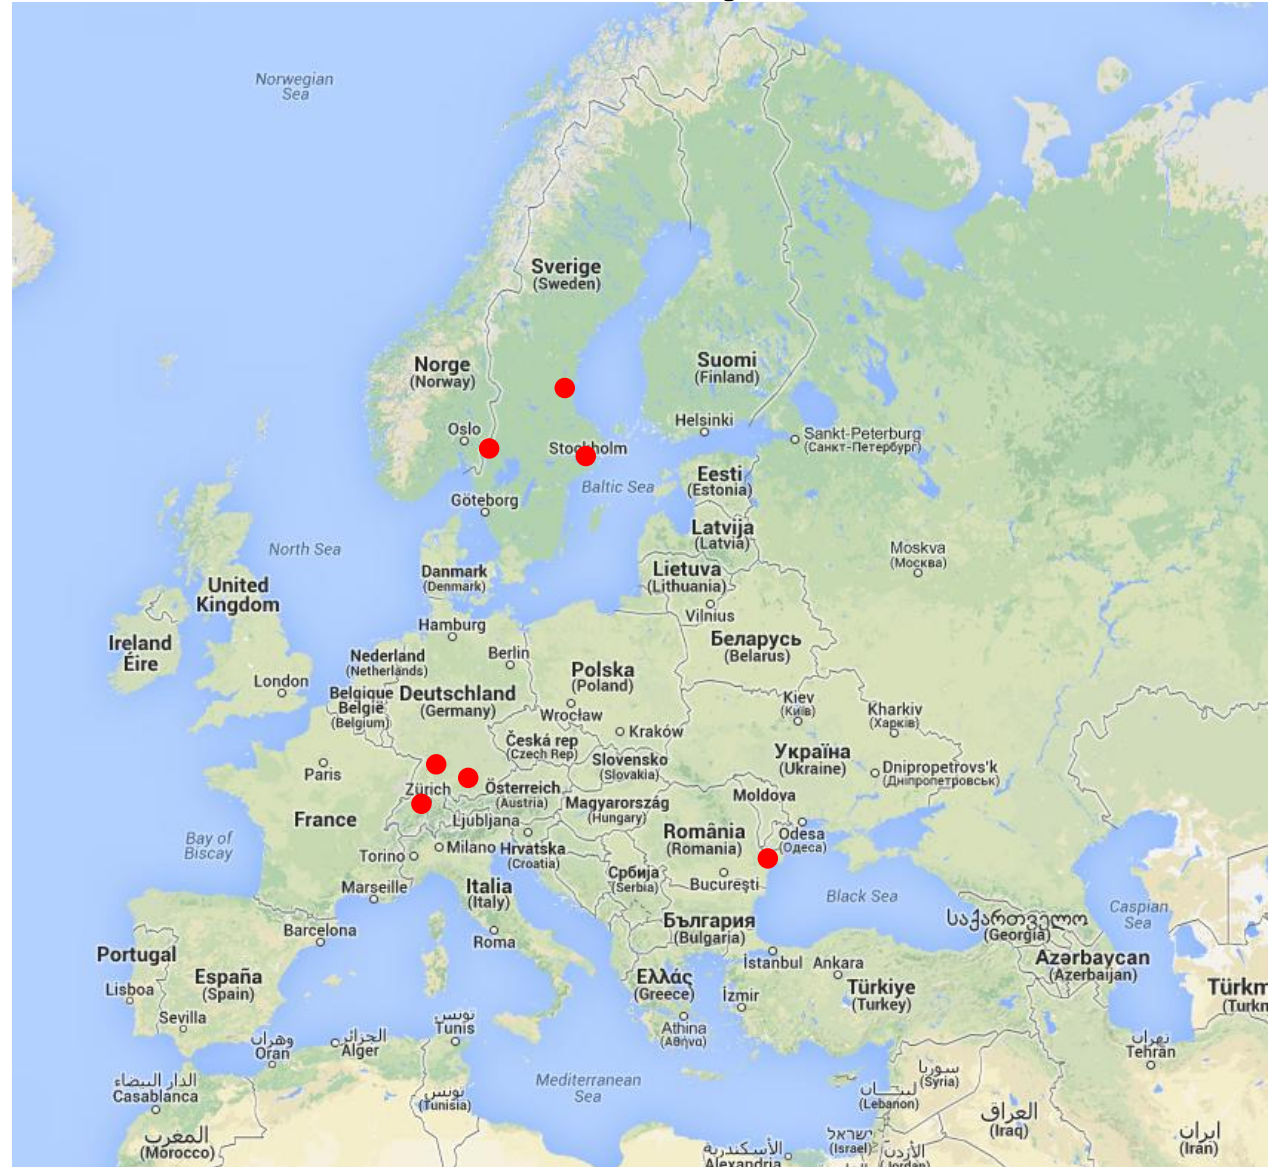

solutions for europe

natural refrigerants

15-16 October 2013, Brussels

# Conclusion

- Combines all thermal demands in one system
- Easy to control AC Evaporator, Since the plate Heat Exchangers is flooded
  - No need of controlling Superheat or injection
  - CO<sub>2</sub> Temperature is controlled by Receiver pressure
  - Easy control of glycol or water
- Parallel compressors starts up automatically when enough gas concentration in receiver
- Lower energy consumption compare to traditional CO<sub>2</sub> Booster systems
- Better Heat\_COP when using the parallel compressors during heat reclaim
- Only ONE plug&play technical unit fits all demands
  - No greyzones to HVAC mechanical and electrical contractors
- The low carbon footprint choice for supermarkets
- Ready for southern Europe